


4.1.3.5 Schalldaten

Messpunkt für die Schalldruckmessung

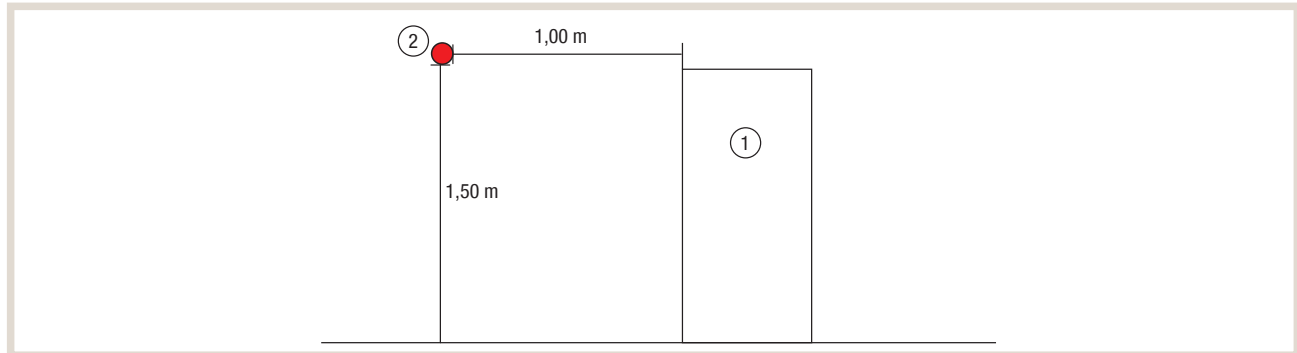

Legende


- 1 Außengerät
- 2 Mikrofon

		Schalldruckpegel [dB(A)] ¹⁾		Schalleistungspegel [dB(A)]
		Heizen	Kühlen	Heizen
Monoblock				
Power Inverter	PUZ-WM50VHA	52	52	61
	PUZ-WM60VAA	45	45	58
	PUZ-WM85YAA	45	45	58
	PUZ-WM112YAA	47	49	60
Zubadan Inverter	PUZ-HWM140YHA	53	53	67
Eco Inverter	QUHZ-W40VA	43	–	53
Split				
Power Inverter	PUD-SWM60VAA	41	–	55
	PUD-SWM80YAA	42	–	56
	PUD-SWM100YAA	44	–	59
	PUD-SWM120YAA	46	–	60
	PUHZ-SW160YKA	62	58	78
	PUHZ-SW200YKA	62	60	78
Zubadan Inverter	PUD-SHWM60VAA	41	–	55
	PUD-SHWM80YAA	42	–	56
	PUD-SHWM100YAA	44	–	59
	PUD-SHWM120YAA	46	–	60
	PUD-SHWM140YAA	48	–	62
	PUHZ-SHW140YHA	52	51	70
	PUHZ-SHW230YKA	59	58	75
Eco Inverter	SUZ-SWM40VA	44	49	58
	SUZ-SWM60VA	45	49	60
	SUZ-SWM80VA	46	49	62


Werte gemessen nach DIN EN 12102

¹⁾ Freifeldmessung bei 1 m Entfernung


■ PUD-SWM60VAA(-BS) PUD-SHWM60VAA(-BS)

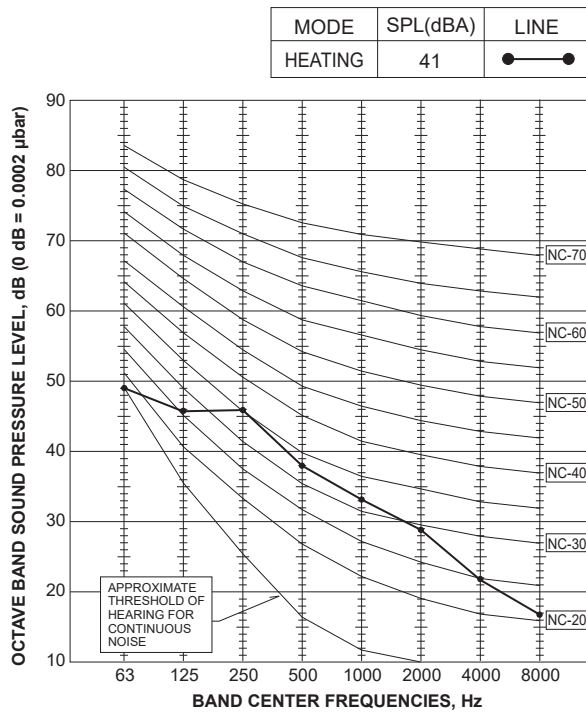


■ PUD-SWM80VAA(-BS) PUD-SWM80YAA(-BS) PUD-SHWM80VAA(-BS) PUD-SHWM80YAA(-BS)

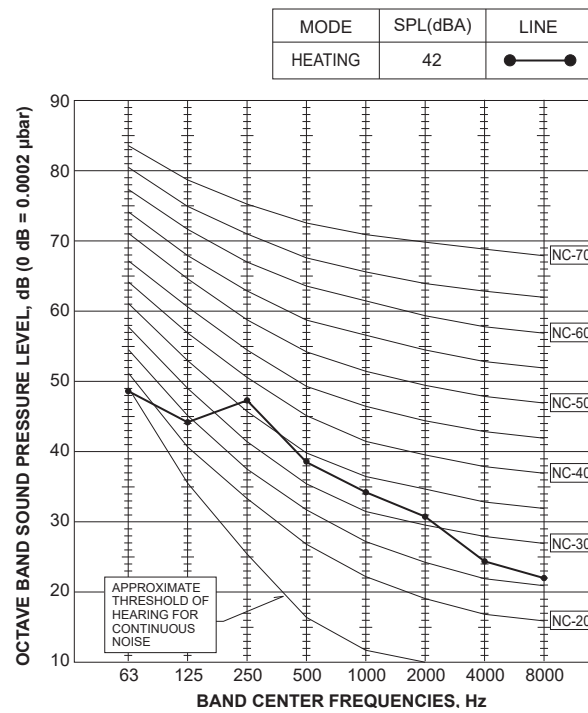

■ PUD-SWM100VAA(-BS) PUD-SWM100YAA(-BS) PUD-SHWM100VAA(-BS) PUD-SHWM100YAA(-BS)

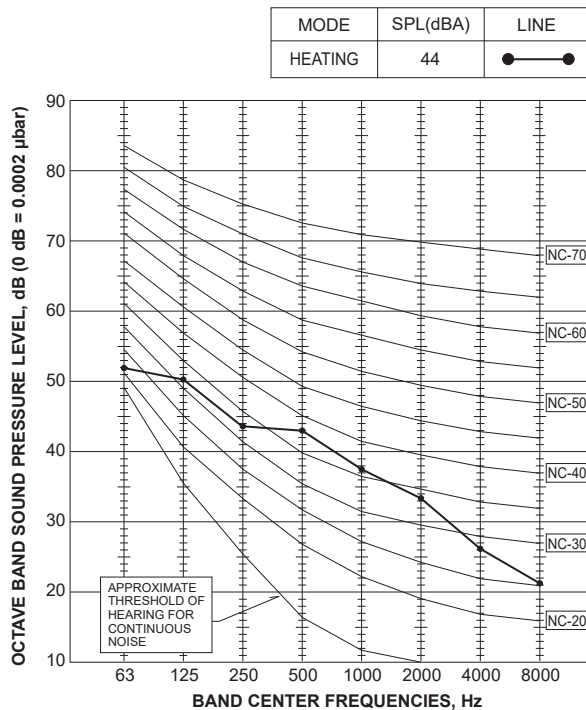


■ PUD-SWM120VAA(-BS) PUD-SWM120YAA(-BS) PUD-SHWM120VAA(-BS) PUD-SHWM120YAA(-BS)

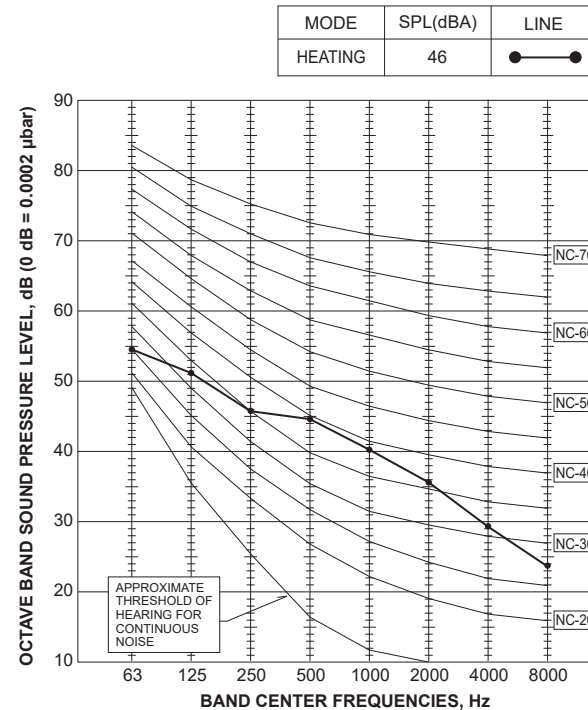


<Notes>

- 1) Sound data is taken when the system is running stably.
- 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.

■ PUD-SWM60VAA(-BS)
PUD-SHWM60VAA(-BS)

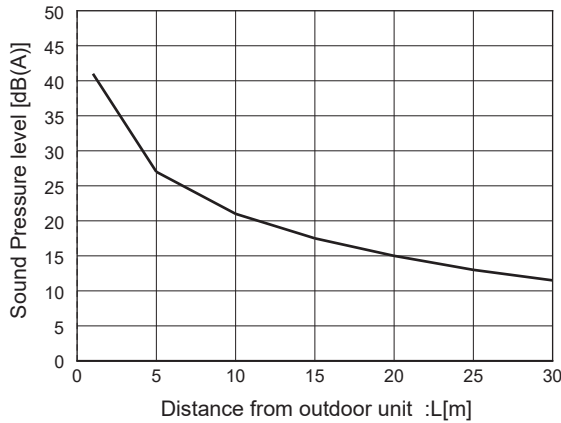


■ PUD-SWM80VAA(-BS)
PUD-SWM80YAA(-BS)
PUD-SHWM80VAA(-BS)
PUD-SHWM80YAA(-BS)

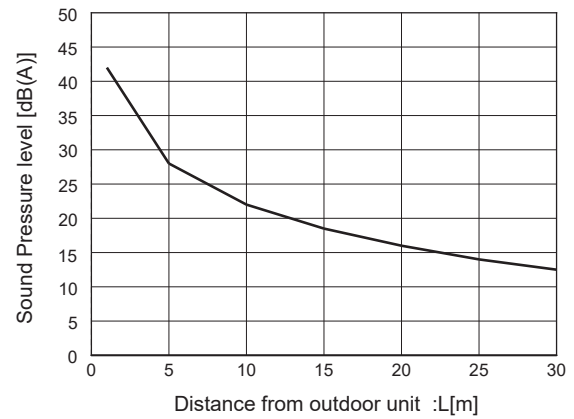

■ PUD-SWM100VAA(-BS)
PUD-SWM100YAA(-BS)
PUD-SHWM100VAA(-BS)
PUD-SHWM100YAA(-BS)



■ PUD-SWM120VAA(-BS)
PUD-SWM120YAA(-BS)
PUD-SHWM120VAA(-BS)
PUD-SHWM120YAA(-BS)

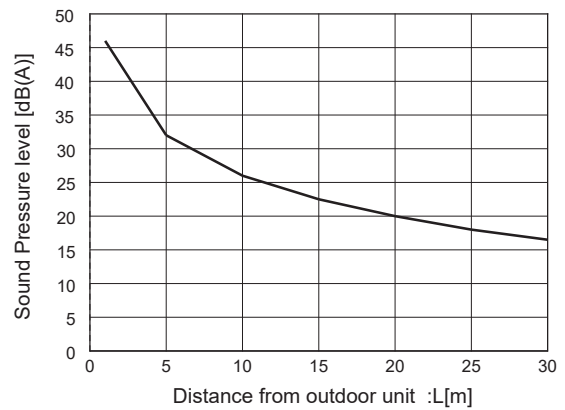

■ PUD-SHWM140VAA(-BS)
PUD-SHWM140YAA(-BS)

